



OpenAir™

## Actuators for Fire Protection Dampers

**GGA126.1E/..**  
**GGA326.1E/..**

Rotary version, 2-position control, with spring return and optional ready connected temperature monitoring unit, AC 24 V / DC 24...48 V or AC 230 V

Electric motor driven actuators for 2-position control, nominal torque 18 Nm, with spring return to failsafe position, mechanically adjustable span between 0...90°, prewired with 0.9 m long connecting cables.

Optional temperature monitoring unit with 2 thermal cutouts (72 °C) and test button.

Special version with fixed auxiliary switches for switching points 5° and 80°, rigid connection between actuator and damper shaft.

### Use

For the control of fire protection dampers.

- Nominal torque of 18 Nm for damper surfaces up to about 3 m<sup>2</sup> (friction-dependent)
- In fire protection sections of plant where, in the event the thermal fuse cuts out at a duct or ambient temperature of 72 °C, or in case of a power failure, the actuator must travel to the failsafe position (zero position)

## Functions

### Basic functions

Rotary movement	<ul style="list-style-type: none"> <li>Direction of rotation (clockwise or counterclockwise) determined by the way the actuator is mounted on the damper shaft</li> <li>When operating voltage is applied, the actuator travels toward the 90° position</li> </ul>
Failsafe function	<ul style="list-style-type: none"> <li>If the thermal fuse cuts out at a duct or ambient temperature of 72 °C, the return spring drives the actuator to the failsafe position (0°)</li> <li>In the event of a power failure or if the operating voltage is turned off, the return spring drives the actuator to the failsafe position (0°)</li> </ul>
Behavior in the event the damper is blocked	The actuator is equipped with an automatic switch-off mechanism.
Position indication	The position indicator located on the shaft adapter shows the rotational angle position of the damper blade.
Manual adjustment when actuator is dead	<ul style="list-style-type: none"> <li>When dead, the actuator can be driven to any angular position using a hex wrench and can then be secured with a screwdriver</li> <li>The actuator returns to its zero position when mechanically delocked with a hex wrench (turning toward "90° - opening") or by applying power for a short moment</li> </ul>

### Specific functions

Auxiliary switches	Fixed switching points at 5° and 80°.
Rigid connection	Square shafts 8 x 8, 10 x 10, 12 x 12 mm, or 15 x 15 mm.

### Type summary

Operating voltage	Auxiliary switches	With temperature monitoring unit	Without temperature monitoring unit
AC 24 V DC 24...48 V	Fixed switching points at 5° and 80°	<b>GGA126.1E/T08</b> <b>GGA126.1E/T10</b> <b>GGA126.1E/T12</b> <b>GGA126.1E/T15</b>	<b>GGA126.1E/08</b> <b>GGA126.1E/10</b> <b>GGA126.1E/12</b> <b>GGA126.1E/15</b>
AC 230 V	Fixed switching points at 5° and 80°	<b>GGA326.1E/T08</b> <b>GGA326.1E/T10</b> <b>GGA326.1E/T12</b> <b>GGA326.1E/T15</b>	<b>GGA326.1E/08</b> <b>GGA326.1E/10</b> <b>GGA326.1E/12</b> <b>GGA326.1E/15</b>

**Delivery** Due to the mounting choices depending on the direction of rotation and the shaft length, shaft adapter with position indicator and other mounting accessories are shipped unassembled together with the actuator.

**Connecting cables** The actuators come with 0.9 m long prewired connecting cables. The cable length to the ready fitted temperature monitoring unit is 0.9 m.

### Accessories

Designation	Type reference	Data sheet / mounting instruction
Interlocking plate	<b>ASK79.3/08</b> <b>ASK79.3/10</b> <b>ASK79.3/12</b> <b>ASK79.3/15</b>	M4612
Temperature monitoring unit	<b>ASK79.2</b>	N4617 / M4617.2

⚠ Note

Accessory Interlocking plate ASK79.3/.. has always to be used if the fire damper doesn't have any self-locking mechanism.

## Equipment combinations

---

The damper actuators can be used with all types of controllers having a 2-position output and delivering a switching voltage of AC 24 V / DC24...48 V or AC 230 V.

## Technical design

---

Drive motor	The brushless DC motor ensures accurate speed control, torque monitoring for protecting the actuator and the air damper, and provides a reliable failsafe function.
Spring return mechanism in the event of power failure	Springs ensure the failsafe function.

## Mechanical design

---

### Basic components

Housing	Robust, lightweight all metal housing made from die-cast aluminium which guarantees long service life even under extreme environmental conditions.
Gear train	Maintenance- and noise-free gear train with stall and overload protection for the life of the actuator.
Spring preload	The spring has a factory-set preload of 5° to ensure tight shutoff for the fire protection dampers.
Manual adjustment	A hole with a screw in the center of the actuator allows manual setting of the gears. A hex wrench is supplied.
Mounting bracket	A perforated bracket with pin available, depending on the way the actuator is fixed.
Electrical connection	All actuators come with prewired 0.9 m long connecting cables.
Note	The actuator can be mounted on either side depending on the required direction of rotation. All setting and operating elements are available on both sides of the actuator.

### Specific elements

Auxiliary switches Fixed switching points at 5° and 80°.

### Temperature

#### monitoring unit

#### Use


The temperature monitoring unit is ready connected to the actuator and is used for forced control of motorized fire protection dampers should excessive temperatures occur.

#### Mode of operation

The temperature monitoring unit contains 2 thermal fuses, one for monitoring the duct temperature and one for the ambient temperature. If the temperature at any of these fuses exceeds the level of 72 °C, the power supply will be irreversibly cut. As a result, the return spring will drive the actuator to the failsafe position. A test button is integrated for making functional checks. When pressed, the current path will be cut.


**Setting and operating elements**

Refer to "Technical design" and "Commissioning notes" in this data sheet.

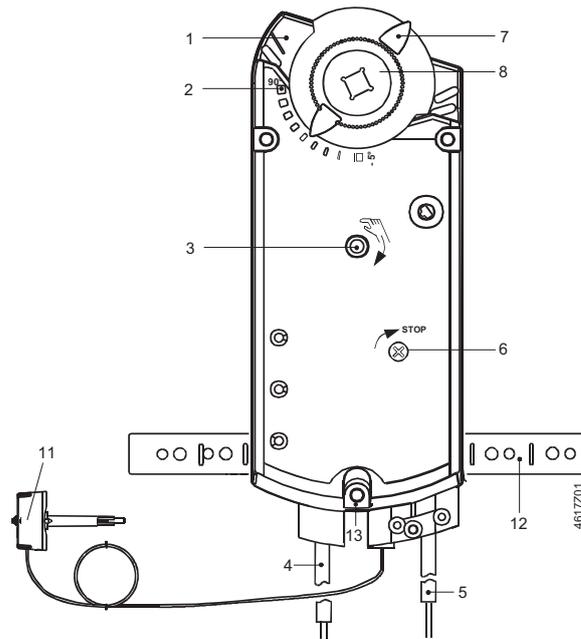

- 1 Housing
- 2 Angle of rotation scale 0°...90°
- 3 Screw for manual override
- 4 Connecting cable for power supply
- 5 Connecting cable for auxiliary switches
- 6 Stop shaft for geartrain
- 7 Position indicator
- 8 Shaft adapter
- 9 Locking ring for shaft adapter
- 10 Adapter for position indicator
- 11 Temperature monitoring unit
- 12 Mounting bracket
- 13 Pin

**Arrangement for shaft adapters**

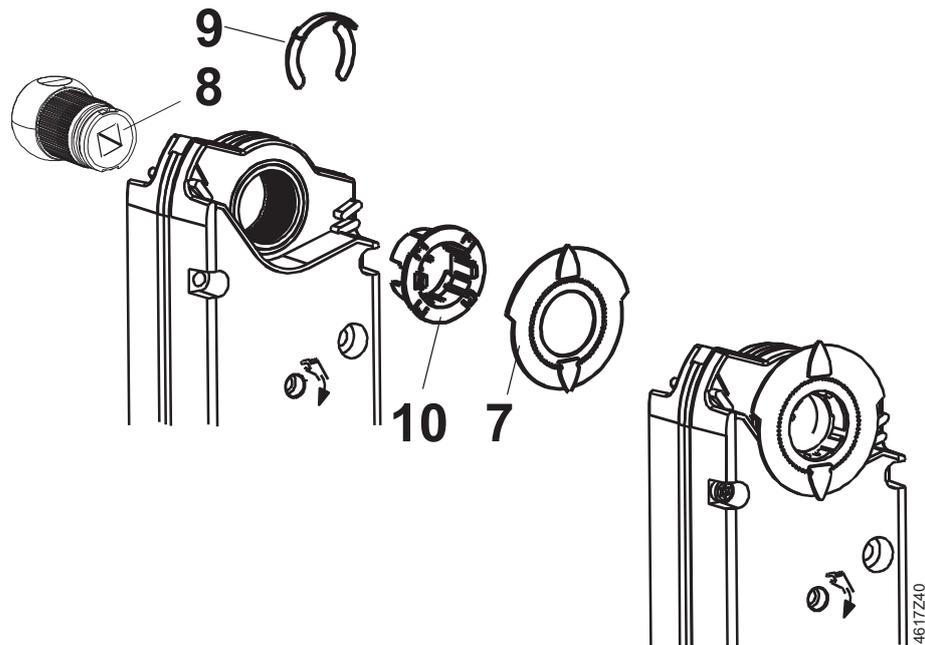

## Engineering notes

---



The basic system data for the control systems in use contain all engineering notes. Read all the engineering notes before mounting, wiring and commissioning the damper actuator and pay special attention to all safety instructions.

Correct use

These damper actuators must be used on applications as described in the basic system data documents for the relevant control systems. Additionally, all actuator-specific features and rules must be observed as described in the brief description on the front page of this Data Sheet (bold print) and in "Use", "Engineering notes", and "Technical data".



All paragraphs marked with the special warning triangle as illustrated on the left contain additional safety instructions and limitations that must be observed under any circumstances to avoid physical injuries or damage to equipment.



Power supply  
AC 24 V  
DC 24...48 V

These actuators must be used with **safety extra low-voltage (SELV)** or **protection by extra low-voltage (PELV)** in accordance with HD 384.



Power supply  
AC 230 V

The actuators are double-insulated and do not provide a connection for protective ground.



Auxiliary switches  
"A", "B"

Use **either mains voltage or safety extra low-voltage** for auxiliary switches "A" and "B". Do not mix the 2 for operation. Operation with different phases is **not** permitted.



Warning,  
maintenance

**Do not open** the actuator!

The actuator is maintenance-free. Maintenance work may only be carried out by the manufacturer.

Parallel connection  
of actuators

Electric parallel connection of the same types of actuator is permitted provided operating voltage is within the required tolerance. Voltage drops on the supply lines must be taken into consideration

Sizing transformers  
for AC 24 V

- Use safety isolating transformers with double insulation conforming to EN 60 742. The transformers must be suited for 100 % duty
- Observe all local safety rules and regulations relating to the sizing and protection of transformers
- Determine the transformer's size by adding up the power consumption in VA of all actuators used

Wiring and commissioning

Refer to "Commissioning notes" and "Internal diagram" as well as to the plant diagram.

## Mounting notes

---

Mounting instructions

For detailed information on the correct preparation of the actuator, refer to Mounting Instructions GGA...1E/.. M4617. The actuator must be fitted to the fire protection damper as specified by the OEM. Shaft adapter and other accessory items come unassembled, since their assembly depends on the direction of rotation and the length of the shaft (refer to "Technical design").

Housing protection

In order to comply with the requirements of IP 54 (temperature monitoring unit has IP 30), the following mounting conditions must be satisfied:

- Always mount the actuator vertically (cable entry at the bottom) in the case of air dampers with horizontal shafts
- When the actuator is mounted directly on the damper shaft, the mounting angle may be a maximum of  $\pm 45^\circ$

Mounting bracket /

If the actuator is mounted directly on the damper shaft, the mounting bracket / pin must

دقیق صنعت پیشرو

اتوماسیون و سیستمهای کنترل

Building Technologies

HVAC Products

Damper shafts	For information on minimum length and diameter of the damper shaft, refer to "Technical data".
Spring preload	The actuator is supplied with a 5° spring preload to ensure a certain closing pressure for the air damper.
Mechanical limitation of the rotational angle	If required, the angle of rotation can be limited in increments of 5° for the entire correcting span by placing the shaft adapter in the respective position.
<b>Temperature monitoring unit</b>	The temperature monitoring unit is to be fitted to the duct wall or the damper housing using 2 self-tapping screws of 3.5 mm diameter. The enclosed drilling template facilitates mounting. When mounting, it must be ensured that the thermal fuse is fully exposed to the airflow.

### Commissioning notes

---

References	All information required for commissioning is contained in the following pieces of documentation: <ul style="list-style-type: none"> <li>• The present Data Sheet N4617</li> <li>• Mounting Instructions M4617</li> <li>• Plant diagram</li> </ul>
Environmental conditions	<ul style="list-style-type: none"> <li>• Check to ensure that all permissible values as specified in "Technical data" are observed</li> </ul>
Mechanical check	<ul style="list-style-type: none"> <li>• Check for proper mounting to ensure that all mechanical settings are in accordance with plant-specific requirements. In addition, ensure that the air dampers are shut tight when in the fully closed position</li> <li>• Fasten the actuator securely to avoid side load</li> <li>• Check the direction of rotation by turning the gearing with a hex wrench in accordance with the Mounting Instructions</li> </ul>
Electrical check	<ul style="list-style-type: none"> <li>• Check to ensure that the cables are connected in accordance with the plant wiring diagram</li> <li>• Operating voltage AC 24 V / DC 24...48 V (SELV / PELV) or AC 230 V must be within the tolerance</li> <li>• Auxiliary switches "A" and "B" change over when the actuator reaches the respective positions</li> </ul>
<b>Temperature monitoring unit</b> 	<p>Functional check on site:</p> <p>Press the button to simulate overtemperature. This simulates the response of the fuse, enabling you to check the proper functioning of the actuator.</p> <p>In plant equipped with a fire alarm device BAM, fire alarm will be triggered. Appropriate measures must be taken before the functional check is made.</p>

## Technical data

⚠ Power supply AC 24 V DC 24...48 V (SELV/PELV)	Operating voltage AC / frequency	AC 24 V ±20 % / 50/60 Hz
	Operating voltage (DC)	DC 24...48 V ±20 %
	Power consumption GGA126.1: when running	AC: 7 VA / 5 W
	when running when holding when holding	DC: 4 W AC: 5 VA / 3 W DC: 3 W
Safety class		III to EN 60 730
⚠ Power supply AC 230 V	Operating voltage / frequency	AC 230 V ± 10 % / 50/60 Hz
	Power consumption GGA326.1: when running	8 VA / 6 W
	when holding	6 VA / 4 W
Safety class		II to EN 60 730
Mechanical data	Nominal torque	18 Nm
	Maximum torque (blocked)	50 Nm
	Nominal angle of rotation / maximum angle of rotation	90° / 95° ± 2°
	Running time for nominal angle of rotation 90° (motor operation)	90 s
	Closing with spring return (on power failure)	15 s
⚠ Auxiliary switches	AC power supply	
	Switching voltage	AC 24...230 V
	Nominal current res./ind.	AC 6 A / 2 A
	Life: 6 A res., 2 A ind. without load	10 <sup>4</sup> cycles 10 <sup>6</sup> cycles
	DC power supply	
	Switching voltage	DC 12...30 V
	Nominal current	DC 2 A
	Electric strength auxiliary switch against housing	AC 4 kV
	Switching hysteresis	2°
	Factory switch setting	
	Switch A	5°
Switch B	80°	
Connecting cables	Power supply line AC 24 V (wires 1-2)	2 x 0.75 mm <sup>2</sup>
	AC 230 V (wires 3-4)	2 x 0.75 mm <sup>2</sup>
	Auxiliary switch cable (wires S1...S6)	6 x 0.75 mm <sup>2</sup>
	Standard length	0.9 m
Degree of protection	Housing (actuator only)	IP 54 to EN 60 529
Environmental conditions	Operation / transport	IEC 721-3-3 / IEC 721-3-2
	Temperature	-32...+50 °C / -32...+50 °C
	Humidity (non-condensing)	< 95 % r.h. / < 95 % r.h.
Standards and directives	Product safety: automatic electrical controls for household and similar use	EN 60 730-2-14 (mode of action type 1)
	Electromagnetic compatibility (EMC):	
	Immunity for all models	IEC/EN 61 000-6-2
	Emissions for all models	IEC/EN 61 000-6-3
	☑ Conformity: electromagnetic compatibility	89/336/EEC
	Low-voltage directive	73/23/EEC
	☑ Conformity: Australian EMC Framework	Radio Communication Act 1992
Radio Interference Emission Standard	AS/NZS 3548	
Dimensions	Actuator W x H x D (see "Dimensions")	100 x 264 x 71 mm
	Damper shaft: square	8x8, 10x10, 12x12, 15x15 mm
	min. shaft length	20 mm
Weight	Without packaging:	
	GGA126.1E/T... GGA326.1F/T	2.3 kg 2.6 kg


**Temperature monitoring unit**  
(ready connected to actuator  
GGA..26.1E/T..)

Connecting cable  
Switching temperature for sizing  
  
Safety class  
Degree of protection  
Ambient temperature / storage temperature  
Ambient humidity  
Maintenance  
Weight


0.9 m long (2 x 0.5 mm<sup>2</sup>)  
Tf1: outside the duct 72 °C  
Tf2: inside the duct 72 °C  
III (safety extra-low voltage)  
IP30  
-20...+50 °C / -20...+50 °C  
KL D to DIN 40040  
maintenance-free  
80 g

## Diagrams

### Internal diagrams GGA126.1E/T..

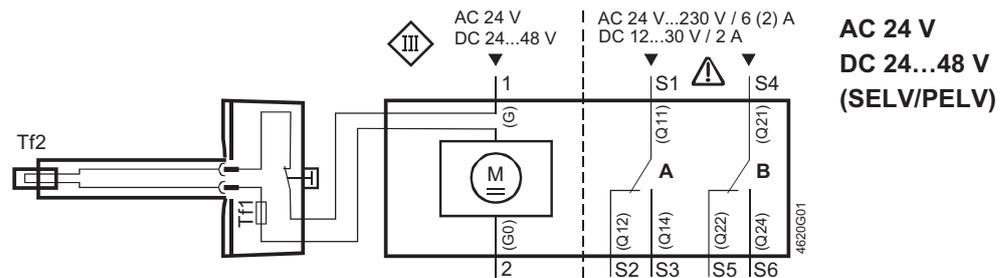

### GGA326.1E/T..

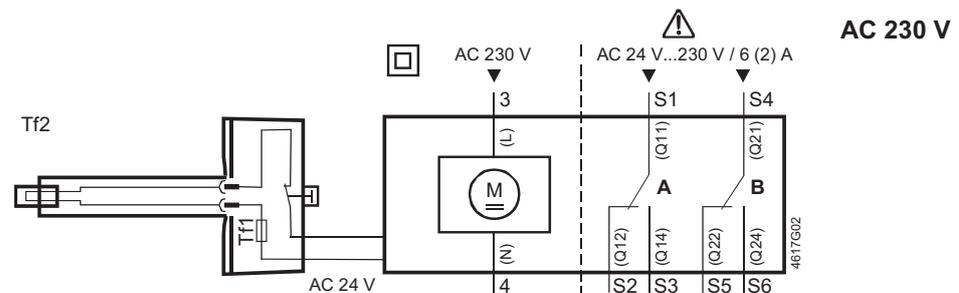


## Wire designations

All wires are color-coded and labeled.

Connection	Cable				Meaning
	Code	No.	Color	Abbreviation	
Actuators AC 24 V DC 24...48 V	G	1	red	RD	System potential AC 24 V / DC 24...48 V
	G0	2	black	BK	System neutral
Actuators AC 230 V	L	3	brown	BN	Line AC 230 V
	N	4	blue	BU	Neutral
Auxiliary switch	Q11	S1	grey/red	GYRD	Switch A input
	Q12	S2	grey/blue	GYBU	Switch A normally-closed contact
	Q14	S3	grey/pink	GYPK	Switch A normally-open contact
	Q21	S4	black/red	BKRD	Switch B input
	Q22	S5	black/blue	BKBU	Switch B normally-closed contact
	Q24	S6	black/pink	BKPK	Switch B normally-open contact

Connection diagram


GGA126.1E/T..

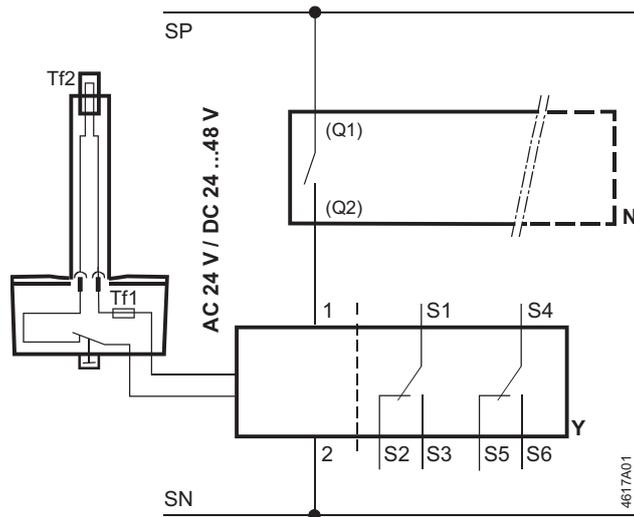

AC 24 V  
DC 24...48 V  
(SELV/PELV)

N Controller  
Y 2-position actuator  
SP System potential  
SN System neutral

GGA326.1E/T..

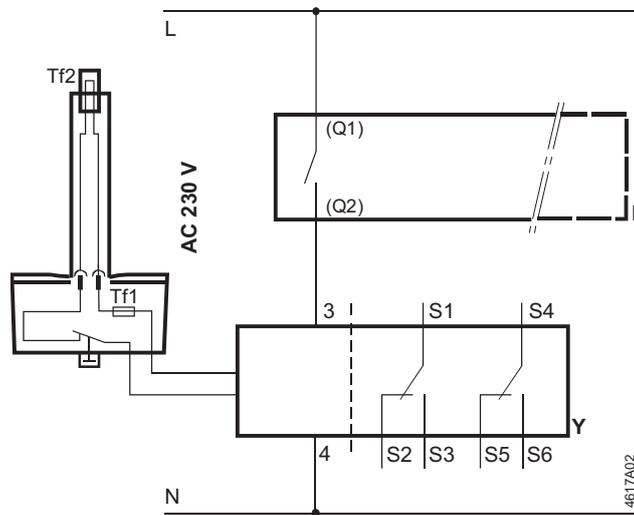


AC 230 V

N Controller  
Y 2-position actuator  
L Live  
N Neutral conductor

## Dimensions

### Actuator

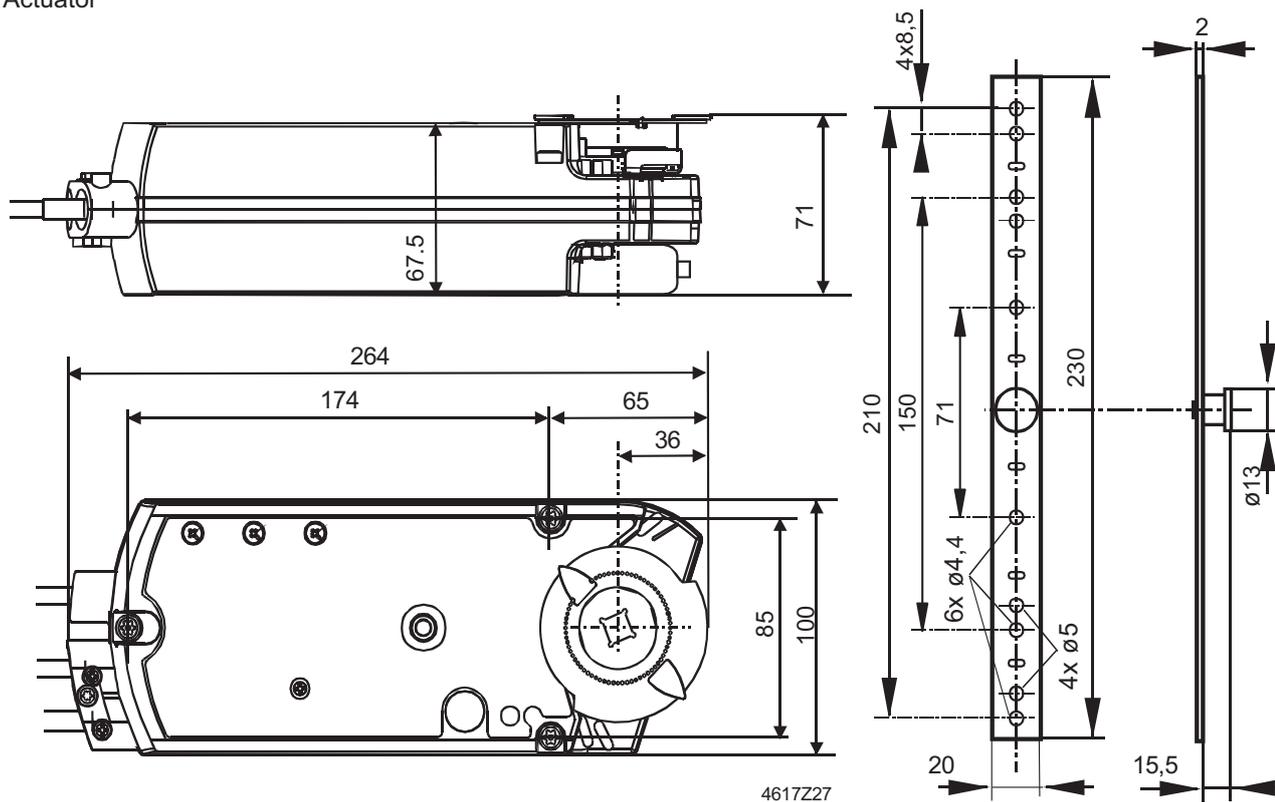

### Temperature monitoring unit

